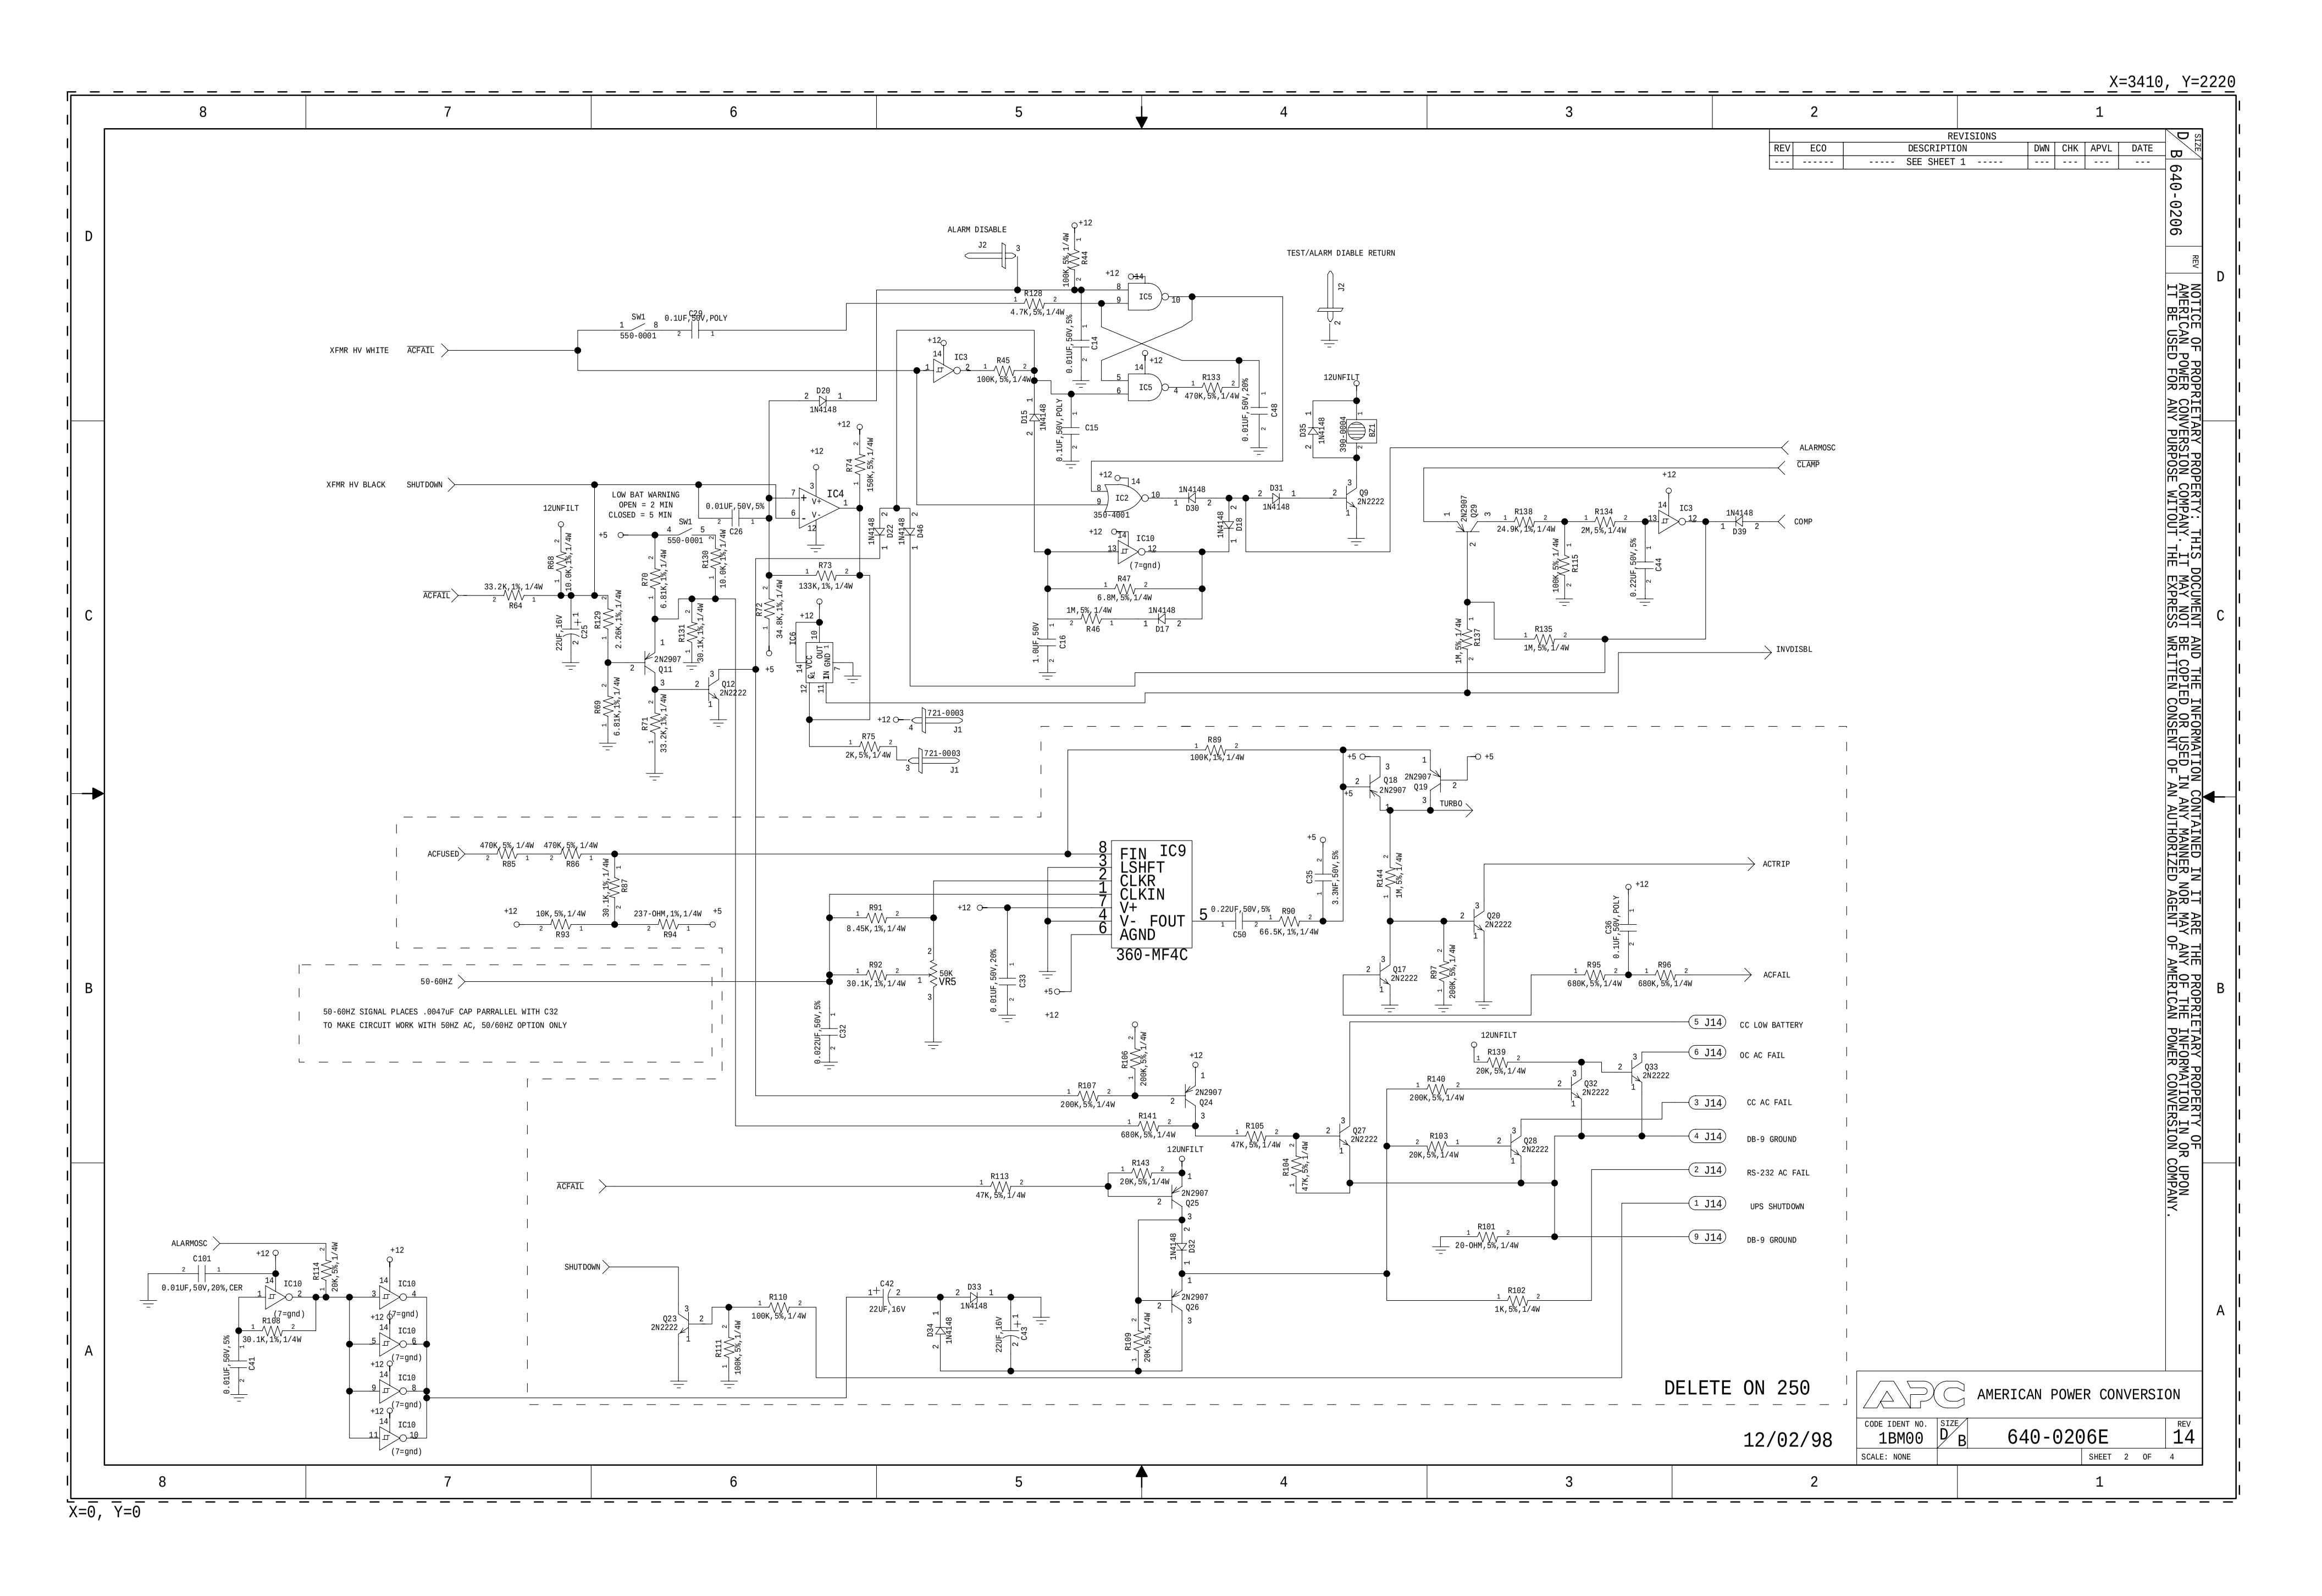


X=3410, Y=2220
X=0, Y=0
NOTICE OF PROPRIETARY PROPERTY: THIS DOCUMENT AND THE INFORMATION CONTAINED IN IT ARE THE PROPRIETARY PROPERTY OF AMERICAN POWER CONVERSION COMPANY. IT MAY NOT BE COPIED OR USED IN ANY MANNER NOR MAY ANY OF THE INFORMATION IN OR UPON IT BE USED FOR ANY PURPOSE WITOUT THE EXPRESS WRITTEN CONSENT OF AN AUTHORIZED AGENT OF AMERICAN POWER CONVERSION COMPANY.
SIZE D B 640-0206 REV
REVISIONS
REV | ECO | DESCRIPTION | DWN | CHK | APVL | DATE
--- | ------ | ----- SEE SHEET 1 ----- | --- | --- | --- | ---
ALARM DISABLE
TEST/ALARM DIABLE RETURN
XFMR HV WHITE
XFMR HV BLACK
ACFAIL
SHUTDOWN
LOW BAT WARNING
OPEN = 2 MIN
CLOSED = 5 MIN
12UNFILT
ALARMOSC
CLAMP
COMP
INVDISBL
ACTRIP
TURBO
ACFUSED
50-60HZ
50-60HZ SIGNAL PLACES .0047uF CAP PARRALLEL WITH C32
TO MAKE CIRCUIT WORK WITH 50HZ AC, 50/60HZ OPTION ONLY
FIN IC9
LSHFT
CLKR
CLKIN
V+
V- FOUT
AGND
360-MF4C
5 J14 CC LOW BATTERY
6 J14 OC AC FAIL
3 J14 CC AC FAIL
4 J14 DB-9 GROUND
2 J14 RS-232 AC FAIL
1 J14 UPS SHUTDOWN
9 J14 DB-9 GROUND
DELETE ON 250
12/02/98
APC AMERICAN POWER CONVERSION
CODE IDENT NO. 1BM00
SIZE D B
640-0206E
REV 14
SCALE: NONE
SHEET 2 OF 4